

# Human Peptide Ready HLA-A\*11:01&B2M Monomer Protein

Cat. No. MHC-HM41R

## Description

<b>Source</b>	Recombinant Human Peptide Ready HLA-A*11:01&B2M Monomer Protein is expressed from HEK293 with His tag and Avi tag at the C-Terminus. It contains Gly25-Thr305(HLA-A*11:01) and Ile21-Met119(B2M).
<b>Accession</b>	AAV53343.1(HLA-A*11:01)&P61769(B2M)
<b>Molecular Weight</b>	The protein has a predicted MW of 48.50 kDa. Due to glycosylation, the protein migrates to 50-60 kDa based on Tris-Bis PAGE result.
<b>Endotoxin</b>	Less than 1EU per µg by the LAL method.
<b>Purity</b>	> 95% as determined by Tris-Bis PAGE > 95% as determined by HPLC

## Formulation and Storage


<b>Formulation</b>	Supplied as 0.22µm filtered solution in PBS (pH 7.4).
<b>Storage</b>	Valid for 12 months from date of receipt when stored at -80°C. Recommend to aliquot the protein into smaller quantities for optimal storage. Please minimize freeze-thaw cycles.

## Background

Peptide Ready HLA-A\*11:01&B2M Monomer is absent from peptide, namely peptide-receptive MHC. It can be loaded with antigenic peptides matching HLA-A\*11:01. Peptide ready MHC molecules comprising human HLA alleles and B2M, which can be readily tetramerized and loaded with peptides of choice in a high-throughput manner.


## Assay Data

### Tris-Bis PAGE

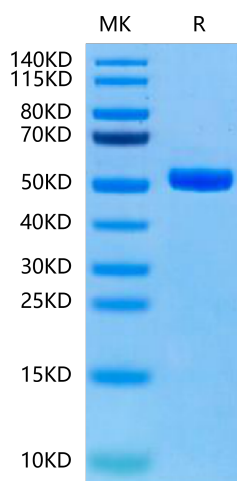

Human Peptide Ready HLA-A\*11:01&B2M Monomer on Tris-Bis PAGE under reduced condition. The purity is greater than 95%.

### SEC-HPLC

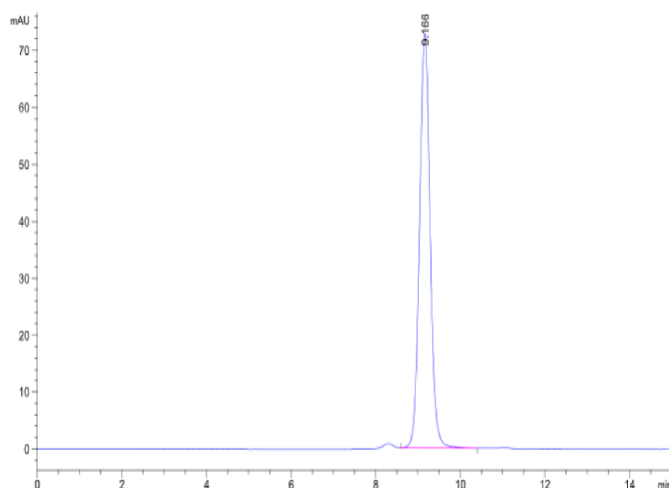

The purity of Human Peptide Ready HLA-A\*11:01&B2M Monomer is greater than 95% as determined by SEC-HPLC.


### ELISA Data

For Research Use Only

Assay Data

**Human Peptide Ready HLA-A\*11:01&B2M Monomer, His Tag ELISA**

0.1µg Human Peptide Ready HLA-A\*11:01&B2M Monomer, His Tag Per Well

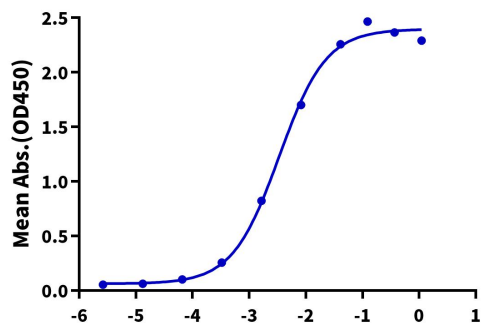

Log Anti-HLA class I (W6/32) Antibody, hFc Tag Conc.(µg/ml)

Immobilized Human Peptide Ready HLA-A\*11:01&B2M Monomer, His Tag at 1µg/ml (100µl/well) on the plate. Dose response curve for Anti-HLA class I (W6/32) Antibody, hFc Tag with the EC50 of 3.4ng/ml determined by ELISA.